

## Engineering Specification

Job Name \_\_\_\_\_

Contractor \_\_\_\_\_

Job Location \_\_\_\_\_

Approval \_\_\_\_\_

Engineer \_\_\_\_\_

Contractor's P.O. No. \_\_\_\_\_

Approval \_\_\_\_\_

Representative \_\_\_\_\_

# LEAD FREE\*

## MasterSeries® LF886V-FS

### Reduced Pressure Zone Detector Backflow Prevention Assemblies (Type-II)

2½" – 10"

FEBCO® MasterSeries® LF886V Reduced Pressure Zone Detector Assembly is specifically designed to protect against possible backpressure and backsiphonage conditions for high hazard (that is, toxic) application in accordance with Local Governing Water Utility Codes. This backflow preventer is primarily used on potable drinking water systems where Local Governing Codes mandate protection from non-potable quality water being pumped or siphoned back into the potable water system.

The ductile iron body is fused with ArmorTek™ technology to resist corrosion due to microbial induced corrosion (MIC) or exposed metal substrate. The series features Lead Free construction to comply with low lead installation requirements. The Lead Free Reduced Pressure Zone Detector Assemblies shall comply with state codes and standards, where applicable, requiring reduced lead content.

The series includes an integrated flood sensor to detect excessive water discharges from the relief valve. When activated through an add-on sensor connection kit, the flood sensor relays a signal that triggers a multichannel alert (call, email, text) to notify personnel about potential flooding. The add-on sensor connection kit is available for both building management systems, or BMS, and cellular communication. (For more information, refer to *Installation, Maintenance, and Repair Manual, Series LF880V-FS and LF886V-FS.*)

### Features

#### Main Valve:

- Stainless steel relief valve seat and stainless steel check components for maximum performance and durability
- Inline serviceable assembly
- No special tools required for servicing
- Captured modular spring assembly
- Reversible and replaceable discs
- Field replaceable seats
- Ductile iron valve body design
- Utilizes advanced ArmorTek™ coating technology to resist corrosion of internals
- Modular and repairable pressure differential relief valve
- Clapper check assembly
- Captured O-ring design
- Integrated sensor for flood detection, activated by add-on connection kit

\*The wetted surface of this product contacted by consumable water contains less than 0.25% of lead by weight.



LF886V-FS-OSY

#### Auxiliary Bypass:

- Compact bypass design; remains in main valve assembly profile
- Inline serviceable ¾" check assembly
- No special tools required for servicing
- Field replaceable seat and disc
- Detect potential underground water leaks
- Detect unauthorized water usage

#### NOTICE

Use of the integrated flood sensor does not replicate the need to comply with all required instructions, codes, and regulations related to installation, operation, and maintenance of this product, including the need to provide proper drainage in the event of a discharge.

Watts® is not responsible for the failure of alerts due to connectivity or power issues.

#### NOTICE

The information contained herein is not intended to replace the full product installation and safety information available or the experience of a trained product installer. You are required to thoroughly read all installation instructions and product safety information before beginning the installation of this product.

Inquire with governing authorities for local installation requirements.



## Specification

FEBCO MasterSeries LF886V Reduced Pressure Zone Detector Assembly shall be installed on the potable water supply and at each point of cross-connection to protect against possible backpressure and backsiphonage conditions for high hazard (that is, toxic) applications. The assembly shall consist of a main line valve body composed of two (2) independently acting approved clapper style check modules with replaceable seats and disc rubbers. Servicing of both check modules does not require any special tools and are accessed through independent top entry covers. This assembly shall be fitted with UL Classified and FM Approved inlet/outlet resilient seated shut-off valves and contain four (4) properly located resilient seated test cocks as specified by AWWA Standard C511. The auxiliary bypass line contains a 5/8" x 3/4" Water Meter that complies with ANSI/AWWA Standard C700 coupled with an approved check assembly compliant to AWWA Standard C511. The bypass line is designed to detect leaks or unauthorized water usage of the water system while protecting against possible backpressure and backsiphonage conditions for high hazard (that is, toxic) applications. The valve body shall utilize a coating system with built-in electrochemical corrosion inhibitor and microbial inhibitor. Flow and pressure loss performance parameters shall meet the requirements of AWWA Standard C511.

## Model Suffix

FS	Integrated sensor for flood detection
OSY	UL Classified and FM Approved OS&Y gate valves (ANSI/AWWA C515 Compliant)
CFM	Totalizing cubic ft/min 5/8"x 3/4" water meter (ANSI/AWWA C700 Compliant)
GPM	Totalizing gal/min 5/8"x 3/4" water meter (ANSI/AWWA C700 Compliant)
LG	Less shutoff valves (This is NOT an APPROVED ASSEMBLY.)

## Example Ordering Descriptions

4" LF886V-FS-OSY-GPM - Valve assembly fitted with flood sensor, OS&Y shutoff valves, and gallons per minute water meter

4" LF886V-FS-OSY-CPM - Valve assembly fitted with flood sensor, OS&Y shutoff valves, and cubic feet per minute water meter

## Available Components

Wye Strainer	FDA Approved (ASME B16.1 Class 125 & AWWA Class D Flange)
Series 611 Valve Setter	MJ x MJ - Mechanical Joint x Mechanical Joint (AWWA C111/A21.11) MJ x FL - Mechanical Joint x Flange (AWWA C111/A21.11; ASME B16.1 Class 125/AWWA Class D Flange) FL x FL - Flange x Flange (ASME B16.1 Class 125 & AWWA Class D Flange)

## Approvals – Standards

- Foundation for Cross-Connection Control and Hydraulic Research at The University of Southern California (FCCCHR-USC)
- ASSE 1047
- UL Classified\*\* (US & Canada)
- FM Approved\*\*
- IAPMO/cUPC
- AWWA Standard C511 Compliant
- End Connections: Compliant to ASME B16.1 Class 125 & AWWA Class D Flange



## Assembly Flow Orientation

Horizontal (N-Pattern 2 1/2" – 10") - Approved by FCCCHR-USC, ASSE, cULus, FM, IAPMO/cUPC

Vertical Up (Z-Pattern 2 1/2" – 10") - Approved by FCCCHR-USC, ASSE, cULus, FM, IAPMO/cUPC

\*\*Assembly configured with UL Classified and FM Approved OS&Y RW gate valves. Less gate valve assemblies are not UL Classified and FM Approved configurations.


## Materials

All assemblies (sizes 2½" to 10") are similar in materials and construction. Contact your local FEBCO representative if you require further information.

Main Valve Body	Ductile iron Grade 65-45-12
Relief Valve Body	Ductile iron Grade 65-45-12
Coating	Fusion epoxy coated internal and external AWWA C550-90
Shutoff Valves	OSY resilient wedge gate valve AWWA C515 (UL Classified and FM Approved)
Check Seats	Stainless steel
Relief Valve Seat	Stainless steel
Disc Holder	Stainless steel
Elastomer Disc	Silicone
Spring	Stainless steel
Clamp	AWWA C606

## Pressure - Temperature


Max. Working Pressure	175 psi (12.1 bar)
Min. Working Pressure	20 psi (1.4 bar)
Hydrostatic Test Pressure	350 psi (24.1 bar)
Hydrostatic Safety Pressure	700 psi (48.3 bar)
Temperature Range	33°F-140°F (0.5°C- 60°C) continuous

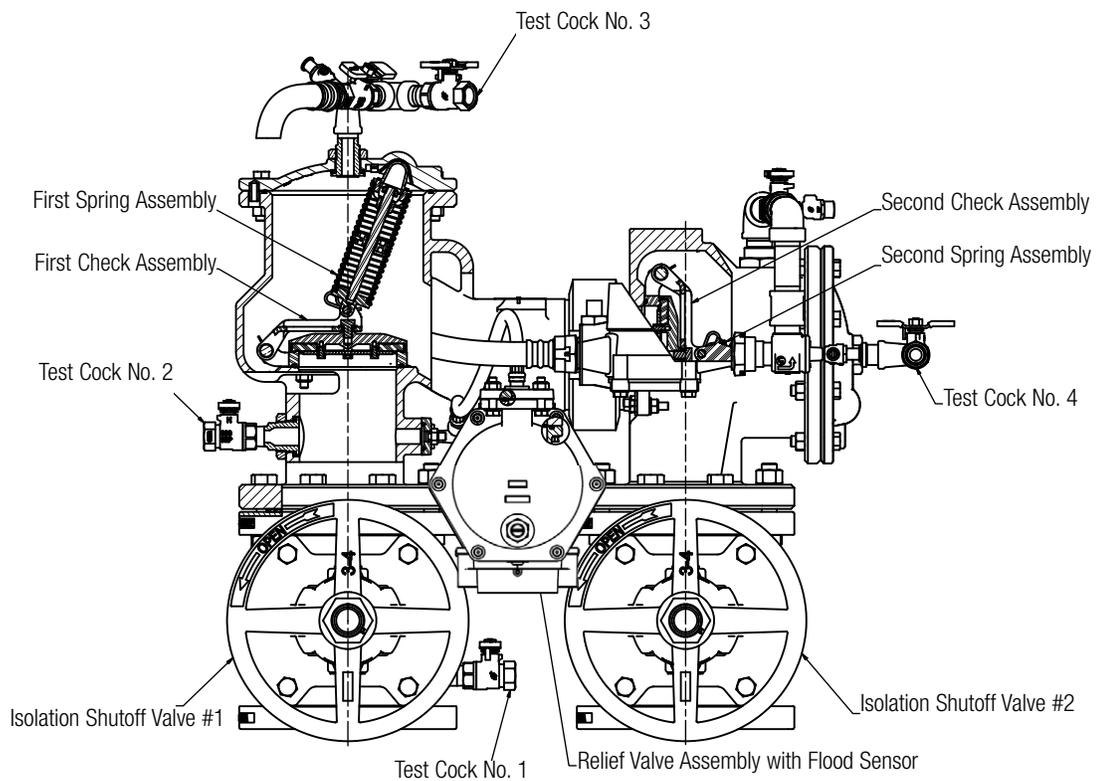




## Dimensions & Weights

Below are the nominal dimensions and physical weights for Model LF886V-FS, sizes 2½" to 10". Allowances must be made for normal manufacturing tolerances. Download installation instructions at [watts.com](http://watts.com), or contact your local FEBCO representative for more information.

### Standard (N-pattern) Orientation

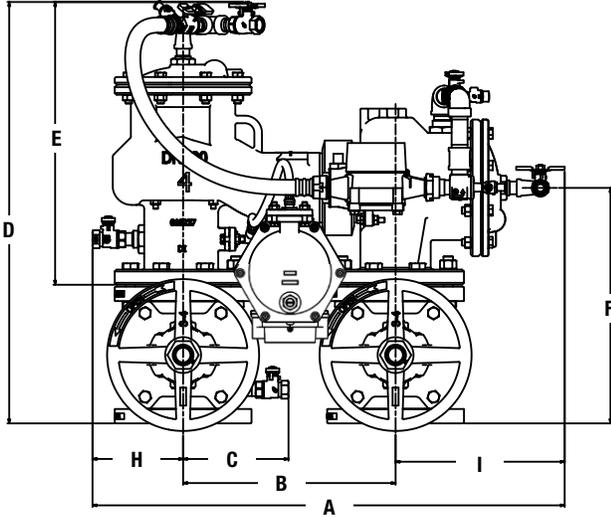

### Vertical (Z-pattern) Orientation

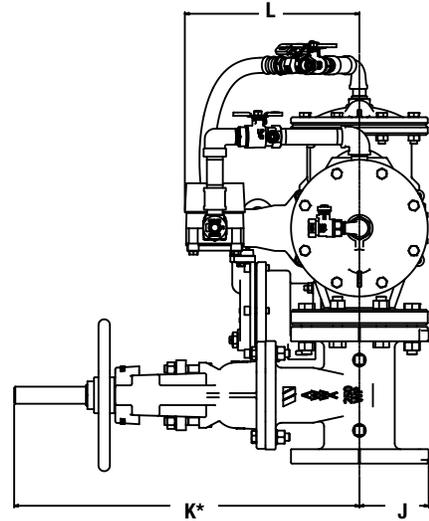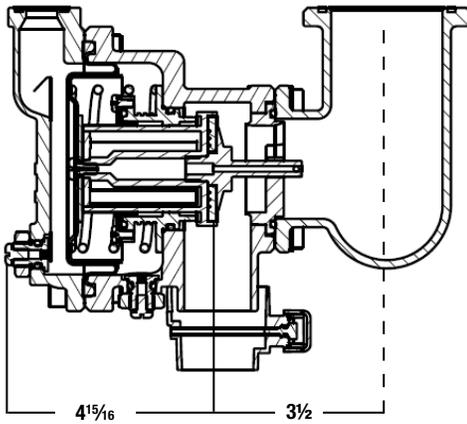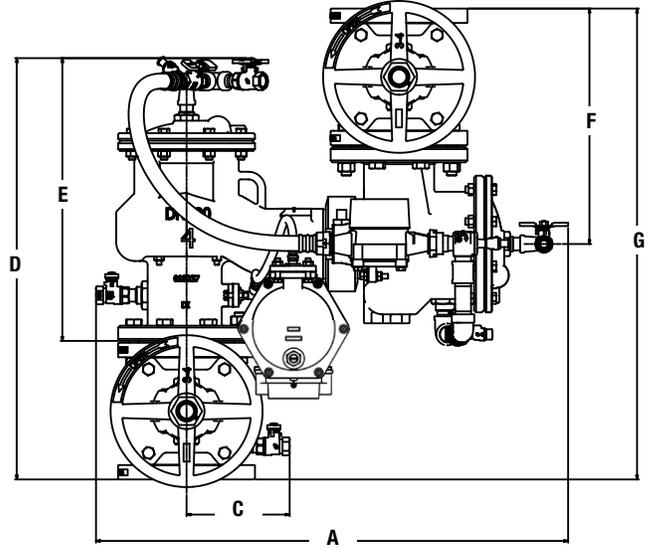

SIZE	DIMENSIONS														WEIGHT**													
	A		B		C		D		E		F		G		H		I		J		K*		L		OSY			
in.	in.	mm	in.	in.	mm	in.	in.	mm	in.	in.	mm	in.	in.	mm	in.	in.	mm	in.	in.	mm	in.	in.	mm	in.	in.	mm	lb	kg
2½	29⅞	740	12½	318	6¼	159	25¼	642	17½	445	13⅝	346	27¼	692	5½	140	11⅞	283	3½	89	16⅞	416	11½	292	240	109		
3	29⅞	740	12½	318	6¼	159	25¾	654	17¾	451	14⅞	359	28¼	718	5½	140	11⅞	283	3¾	95	22¼	565	11½	292	267	121		
4	31⅞	791	14	356	7	178	27¼	705	18¾	476	15½	394	31	787	6	152	11⅞	283	4½	114	23¼	591	13	330	342	155		
6	35¾	908	16	406	8	203	32¼	831	22½	562	18⅞	473	37¼	946	7¼	184	12½	316	5½	140	30⅞	765	13	330	530	240		
8	40¾	1035	18½	470	9¼	235	36¾	933	25⅞	638	20¾	527	41½	1054	8½	216	14	356	6¾	172	37¼	959	14½	368	846	384		
10	46¼	1175	21	533	10⅞	264	41⅞	1047	28⅞	714	23⅞	601	47⅞	1202	9⅞	244	15⅞	398	8	203	45¼	1162	13⅞	333	1363	618		

\* Indicates nominal dimensions with OSY gate valves (full open positions).

\*\* Indicates weight of complete backflow assemblies with specified gate valves.


The gap drain is not designed to catch the maximum discharge possible from the relief valve. The installation of the FEBCO air gap with the drain line terminating above a floor drain handles any normal discharge or nuisance spitting through the relief valve. However, floor drain size may need to be designed to prevent water damage caused by a complete failure condition. Do not reduce the size of the drain line from the air gap fitting.

# Performance

The flow capacity chart identifies valve performance based upon rated water velocity up to 20 fps.

- Maximum service flow rate is determined by maximum rated velocity of 7.5 fps.
- AWWA Manual M-22 (Appendix C) recommends that the maximum water velocity in the services be not more than 10 fps.
- UL flow rate is determined by typically rated velocity of 15 ft/sec.

# Capacity

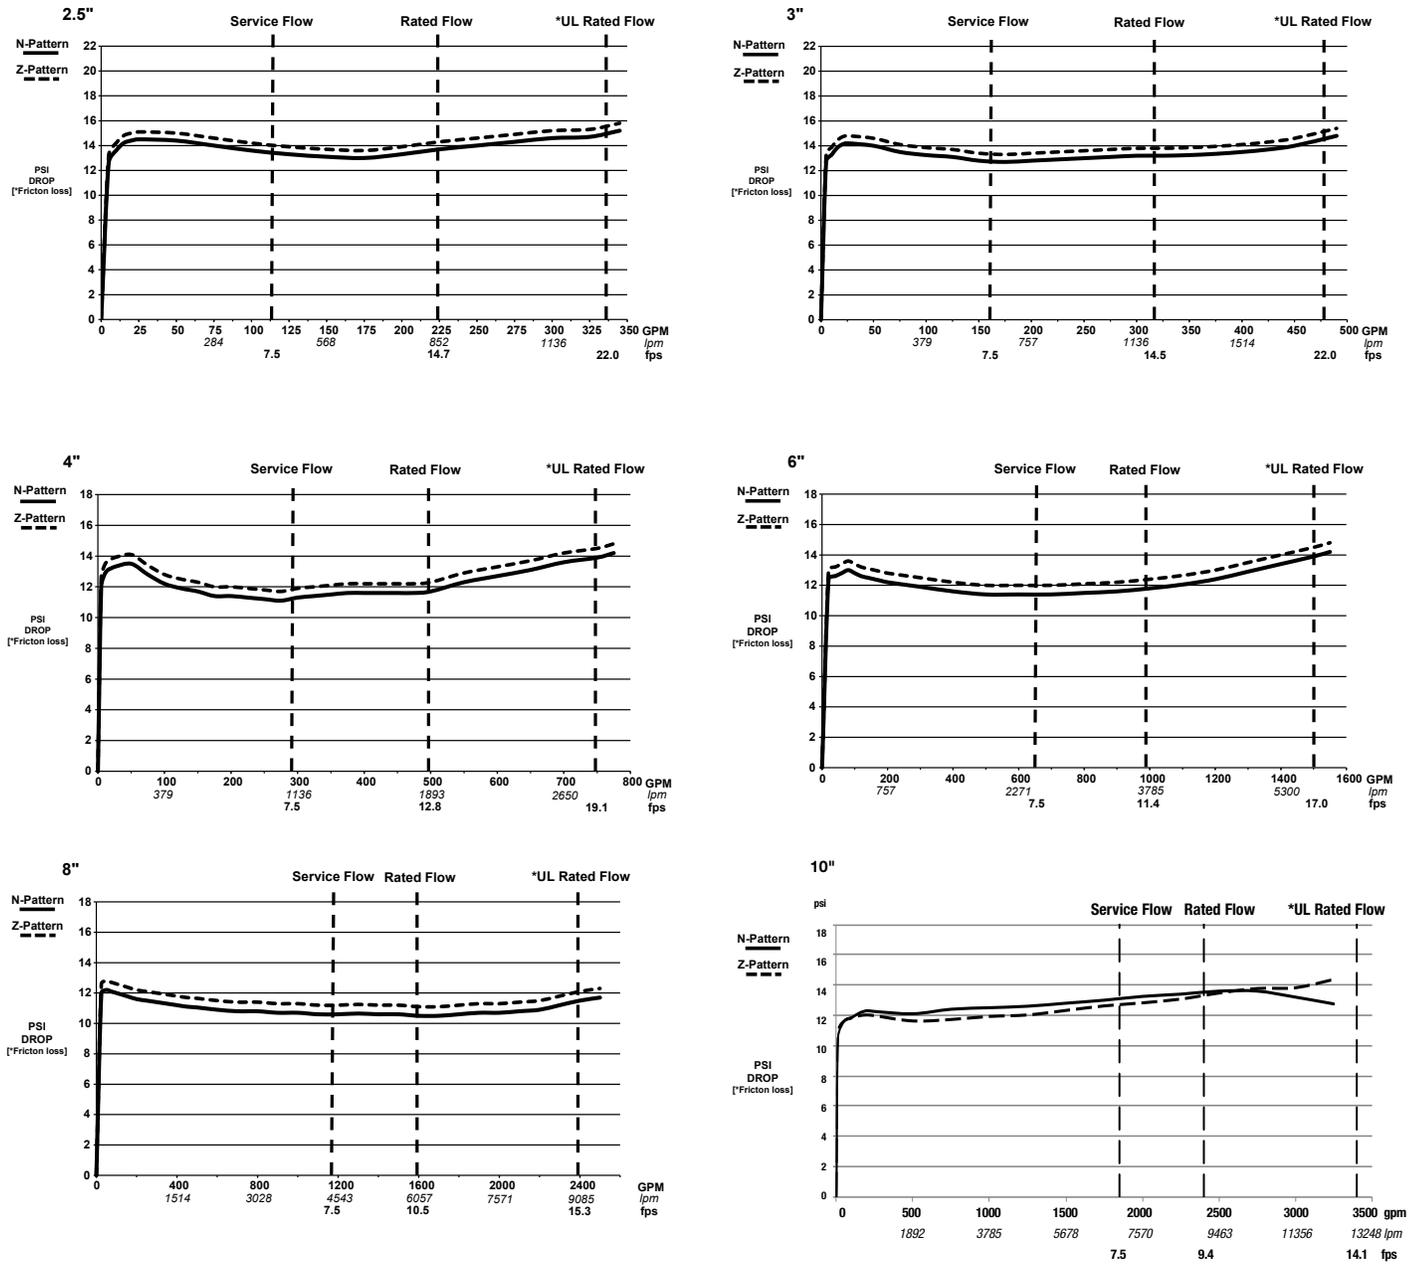

A WATTS Brand

USA: T: (800) 767-1234 • FEBCOonline.com  
 Canada: T: (888) 208-8927 • FEBCOonline.ca  
 Latin America: T: (52) 55-4122-0138 • FEBCOonline.com